


SIZES 1 1/2" - 2"

DOUBLE CHECK VALVES

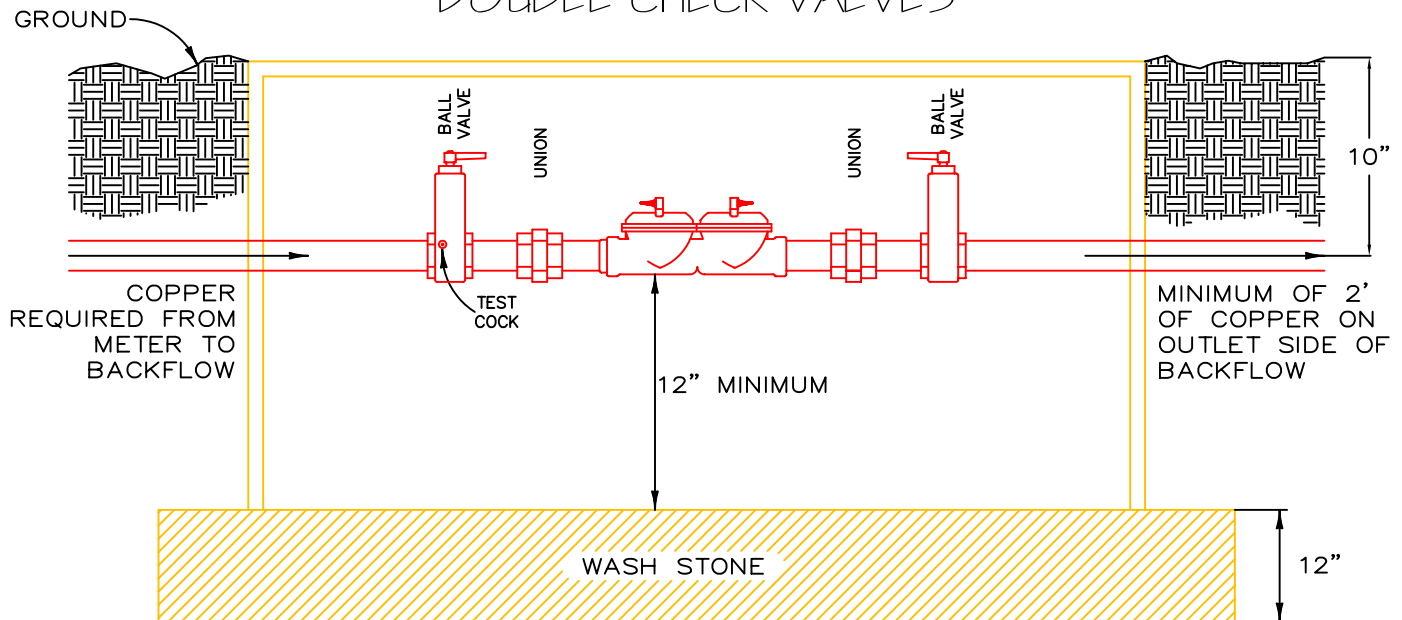

1. THE BACKFLOW DEVICE MUST BE WITHIN 10' OF AND ON THE PROPERTY SIDE OF THE METER.
2. THE UNIT SHALL BE PURCHASED AS AN ASSEMBLY INCLUDING 4 TEST COCKS WITH ONE ON THE CITY SIDE OF THE INLET BALL VALVE.
3. ALL DOUBLE CHECK VALVES MUST BE INSTALLED IN A HORIZONTAL POSITION.
4. SHUT OFF VALVES SHALL BE FULL PORT, LINE SIZE, LEVER TYPE, AND 1/4 TURN BRONZE BALL VALVES.
5. DEVICES SHALL HAVE TWO RESILIENT SEAT BRONZE UNIONS BETWEEN THE SHUT OFF VALVES FOR REMOVAL OF THE DEVICE.
6. THE BOX SHALL BE THE GALVANIZED OVAL SHAPED METER BOX AS MANUFACTURED BY SOUTHEASTERN DISTRIBUTORS.
7. APPROVED UNITS: HERSEY FDC, WILKINS 550 OR 950, FEBCO 805-Y, WATTS 007 OR 709, CONBRACO 40-100.
8. DRAIN REQUIRED IF INSTALLED IN PAVED AREA.
9. TANDEM BACKFLOWS REQUIRED IF SERVING MULTIPLE USERS OR SERVICE CANNOT BE INTERRUPTED.
10. DITCH MUST REMAIN OPEN UNTIL BACKFLOW INSPECTED BY WATER RESOURCES PERSONNEL.

DATE:
6-15-88

DOUBLE CHECK VALVES

CITY OF GREENSBORO

GSO-13

REVISED:
1-13-04

TYPE:
1 1/2" - 2"

WATER RESOURCES
DEPARTMENT

SCALE:
NOT TO SCALE